



ARTICLE

An In-depth Analysis for Optimal Cable Tray Support Span

Sung Wuk Jung Erkan Oterkus*

University of Strathclyde, United Kingdom

ARTICLE INFO

Article history

Received: 7 January 2021

Accepted: 29 January 2021

Published Online: 31 January 2021

Keywords:

Cable tray system

Finite element method

ANSYS

Oil and gas

Offshore

ABSTRACT

Nowadays, it is crucial to reduce the cost of the overall project so that the competitiveness of offshore oil and gas without compromising on quality or safety can be achieved. This study investigates how to define the longest cable tray support span considering constructability in order to reduce the number of supports which is a chief cost of a cable tray system. This study presents not only material and geometry frequently used for cable tray but also the formula to estimate the maximum cable load which can be installed within cable tray. To verify the longest span without increasing the cross-section of cable tray, finite element modelling approach was employed based on ANSYS and comparisons were made between numerical analysis and simplified hand calculation. The constructability for the longer span obtained from finite element analysis has been validated in view of manual handling of the cable tray. It is shown that the optimal span suggested in this paper can lead to a better economic benefit without degrading the constructability. For instance, as the span is longer, the cost of material as well as construction manpower can be saved. It is also expected that this approach will contribute to enhance the competitiveness of offshore oil and gas.

1. Introduction

Global oil and gas markets have faced a significant change with dramatic rise in the US production of shale oil and gas. US shale oil production has increased from approximately 0.4 million barrels a day in 2007 to more than 4 million barrels a day in 2014^[1]. As a result, it has incurred the sharp decline in the global price of oil after 2014 and the investment of offshore oil and gas had been significantly dropped due to relatively high production unit price. In order to recover the offshore oil and gas market, there is effort to reduce the general cost level of offshore oil and gas projects without compromising on quality or safety. For instance, offshore standardization

Joint Industry Project (JIP) was established with various participants such as HHI, DSME, BV, ABS, DNV-GL, Chevron, TechnipFMC and others to reduce cost and increase predictability in international offshore EPC projects by using standardized materials, design and procedures for construction and commissioning in 2015^[2].

A cable tray system is used to support the insulated electrical cable used for power distribution, control and communication in the electrical wiring. Cable tray system has various shapes and sizes in the market. In the design of a cable tray, the most significant cost driver is the cost of the supports. The number of structural steel supports needed in cable tray installation is mainly determined by the support span. Typically, 3m is the maximum support

*Corresponding Author:

Erkan Oterkus,

University of Strathclyde, United Kingdom;

Email: erkan.oterkus@strath.ac.uk

span employed in offshore oil and gas. However, total installed cost for cable tray can be lower if a longer span than industrial practice is utilized in offshore industry.

The simplest way to achieve the longer span is to enhance the cross-section of cable tray. Recently, there were several trials to employ the longer span with thicker cable tray in offshore industry to reduce the overall cost. Despite the cost savings, there are also the negative points caused by the heavier cable tray at longer span. For instance, if the weight of cable tray remarkably increases at longer span, it will cause difficulty in cable tray handling and installation. It is the main reason that more than 3m span length is not generally applied to offshore industry.

Although 3 meter is the commonly employed support span for cable ladder horizontal run in offshore oil and gas industry, it is required to study whether longer span can be utilized without degrading the constructability. To achieve it, first, the maximum cable weight allowed by cable ladder space needs to be defined then the longest span which can meet both NEMA VE 1 and IEC 61537 under the largest load condition shall be evaluated in the view of constructability.

There are several standards to give suggestion for the critical bending moment of the elastic lateral torsional buckling (LTB). However, their formulas are hard to apply to find the failure load of the cable ladder.

In all equations of critical bending moment, the unbraced length of the beam is important variable to determine the M_{cr} . However, it is difficult to clearly define the unbraced length of the beam in cable ladder structure because the rung structures of cable ladder partially restrain the lateral displacement of the side rail as indicated in Figure 1.

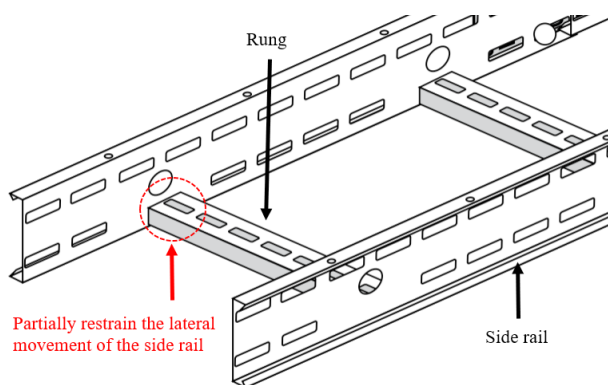


Figure 1. Partial lateral restraint of cable ladder ^[13]

Through finite element analysis to verify the effect of rung at buckling, it has been recognized that the shorter interval between rungs has greater eigen buckling factor (see Table 1).

Table 1. The effect of rung interval length for LTB

Span between support	Interval of rung	Eigen Buckling factor
Total Span: 3.6m Load over span: 6755N	300mm (Total rung Qty: 12ea)	1.2
Total Span: 3.6m Load over span: 6755N	600mm (Total rung Qty: 6ea)	0.5

In addition, the latest version of Eurocode 3 does not specify the method to calculate the elastic critical bending moment for the LTB of beams. The old version of Eurocode 3 named ENV 1993-1: 1992 had the 3-factor formula incorporated though, and the formula is now found in NCCI ^[3]. However, NCCI states the expression of M_{cr} only for uniform straight members that the cross section is symmetric around the minor axis.

For cases not covered by NCCI, critical moment may be determined by a buckling analysis of the beam provided that the calculation accounts for all the parameters liable to affect the value of M_{cr} :

- (1) Geometry of the cross-section
- (2) Warping rigidity
- (3) Position of the transverse loading with regard to the shear centre
- (4) Restraint conditions

Therefore, it is very complicated and difficult work to check the lateral torsional buckling of cable ladder structure indicated in Figure 1 via hand calculation. So, by using numerical methods for the elastic buckling solution, the elastic buckling analysis of the cable ladder needs to be performed to find the failure load of cable ladder as well as the optimal span.

There are various studies in the literature for the analysis of cable trays. Amongst these, Kalupa ^[4] presented guidelines to be used in the design of cable tray systems particularly for electrical industry. Desmond and Dermizakis ^[5] provided effective-length factors for the buckling of cable-tray supports used at nuclear power facilities. Reigles et. al. ^[6] presented a review of test data and conclusions to develop a design methodology for the seismic qualification of safety-related cable tray support systems. Masoni et. al. ^[7] performed shaking-table tests on full-scale three dimensional cable tray systems. In another study, Huang et. al. ^[8] performed shaking table tests to investigate the seismic performance and damping ratio of cable tray systems in nuclear power systems. Huang and Mosalam ^[9] developed a finite element model of the cable tray for time history analysis under the effect of selected ground motions.

In this study, how much span can be longer than off-

shore practice without increasing the cross-section of cable tray is investigated. The geometry including thickness and material which are the most often used for cable tray is described for finite element analysis (FEA) and hand calculation to verify the optimal span. It also provides a method to estimate the maximum cable weight which can be installed in a cable tray. In addition, it suggests how to determine the longest span via FEA considering constructability. Finally, it presents the positive impacts induced by the optimal span which is obtained from this study.

2. Methodology

To define optimal cable tray support span, this research will conduct quantitative analysis for cable tray buckling and deflection at the maximum cable load. The approach adopted is described as below:

Step 1: To define the material property and geometry for the cable tray.

Step 2: To define the criteria to determine the optimal span

Step 3: To calculate the maximum cable load

Step 4: To conduct finite element analysis

Step 5: To conduct simplified hand calculation.

Step 6: To do the verification of result.

2.1 Step 1: Define Material Property and Geometry

Stainless steel ANSI 316L (EN 1.4404) ladder type is selected for this study because it is the most frequently used in offshore oil and gas industry. The mechanical properties for EN 1.4404 from British Standard European Norm is indicated in Table 2.

Table 2. The mechanical property of EN 1.4404 [10-12]

Mechanical property	Value
Poisson's ratio	0.3
Elastic modulus (GPa)	200
Yield strength (MPa) Proof strength	240
Tensile strength (MPa)	520~670

In general, I beam profile can carry more load than C channel beam profile. Therefore, C channel beam shape is selected for side rail of cable ladder in order to define the longest span allowed in worst condition. Figure 2 and Table 3 provides information about the product, OE 150 of Oglænd system [13] which is one of well-known channel type products.

Table 3. The data for geometry

Geometry data	Value
Side rail height (mm)	150
Thickness of side rail (mm)	1.5
Rung length (mm)	900
Moment of Inertia Ixx for the side rail (mm ⁴)	933,170

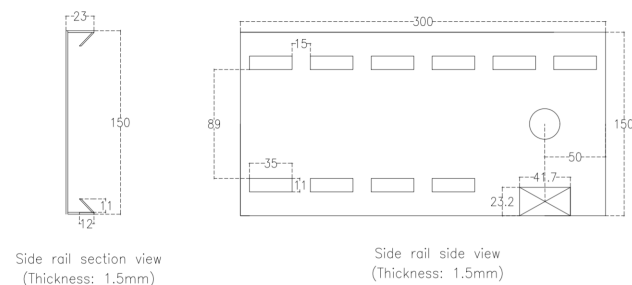


Figure 2. Channel type side rail [13]

2.2 Step 2: Define Criteria to Determine the Optimal Span

There are two kinds of load test methods to verify optimal support span. One is the destruction load test at simple beam and the other is the deflection load test at continuous beam. The optimal support span shall meet both load test criteria at the greatest cable load which is defined in step 3.

2.2.1. NEMA VE-1 Destruction Load Test

Figure 3 shows the NEMA VE 1 safe rated load test (destruction load test) at simple span. In this load test, both ends of straight section shall be supported directly on a 65mm diameter round steel bar or heavy wall steel tube fastened to a rigid base. Then, the load which is 1.5 times (safety factor) of the maximum cable weight defined in step 3 distributed uniformly along the span. In this study, the span increases with interval of 300mm until it causes the collapse [14].

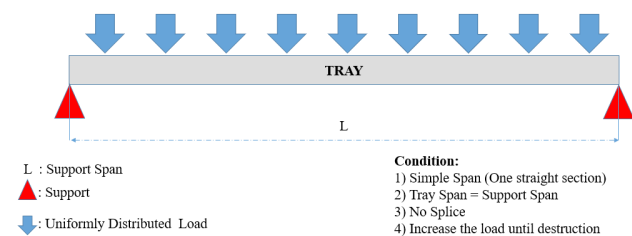


Figure 3. Safe rated load test with simple span according to NEMA VE-1

2.2.2 IEC 61537 Deflection Load Test

The other method is the safety working load (deflection load) test on multiple span based on IEC 61537. The test shall be conducted with the samples consisting of two or more cable ladder lengths over multiple support span given in Figure 4. Cable ladders shall be placed on fixed, rigid supports which shall be horizontal and level with a width of 45mm±5mm. The ladders shall not be fixed to the supports unless a fixing method is declared by the manufacturer in which case this fixing method shall be used^[15].

The load, 1.7 times (safety factor) of the maximum cable load, shall be uniformly distributed on end span, intermediate span and cantilever and each support and splicing(joint) shall be positioned according to Figure 4. The vertical deflection at mid-span shall be measured at the points near the side rails and its result shall be less than 1/100 of span without collapsing in order to meet the IEC criteria but buckling and deformation of the cable ladders is permissible.

The span increases with interval of 300mm until the collapse is caused or the vertical deflection is more than 1/100 of span.

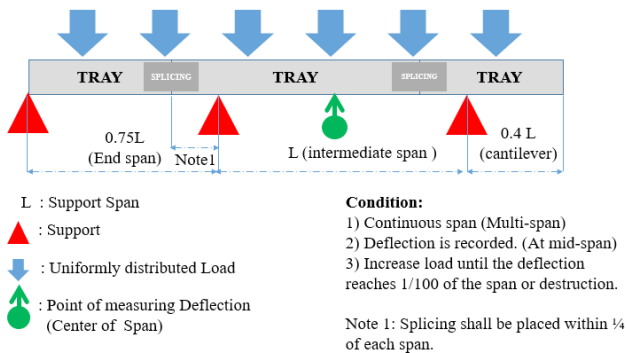


Figure 4. Deflection load test with multiple span according to IEC 61537 type test II

In addition, transverse deflection (rung sagging) is not considered in this study as it is theoretically not affected by support spacing space. Thus, transverse displacement is not discussed here.

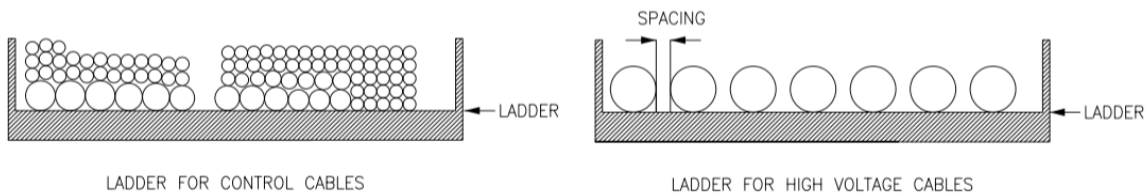


Figure 5. The comparison for cable fill allowance

2.3 Step 3: Calculate Maximum Cable Load

National Electrical Code (NEC) states the high voltage power cables shall be installed in a single layer with certain distance between two cables. However, control and communication cables which has no heat generation problem can be stacked together in several layers as long as the sum of the cross-sectional areas of all cables does not exceed 50% of fill area of the ladder^[16].

Figure 5 shows the ladder fully filled with control cables versus the ladder fully filled with high voltage cables. As indicated in Figure 5, the cross section of cable ladder can be more occupied with the cables when it is fully filled with control cables. Therefore, the largest cable weight can be estimated based on the case that the sum of control cables cross section equals to 50% of fill area of the cable ladder. Following is formula to calculate the maximum cable load depending on ladder cross section.

The largest cable load per one-meter ladder is

$$\text{Max.Cable Load(kg/m)}=N \times m \tag{1}$$

where

$$N = \frac{\Delta h \times W \times 0.5}{A} \tag{2}$$

and Δh is effective height (mm) = $H - H_r$, H is side rail height (mm), H_r is rung height (25mm), W is ladder width (mm), A is cable cross section (mm²), N is maximum cable quantity within ladder cross section, and m is cable weight per meter (kg/m).

Once the maximum cable weight is calculated, the greatest total load can be obtained by adding the ladder unit weight to max. cable unit load as

$$\text{Max.load(N/mm)}=\text{Max.Cable load per mm(N/mm)}+\text{Cable ladder weight(N/mm)}$$

2.4 Step 4: Conduct Finite Element Analysis

Finite element analysis (FEA) to find the optimal tray support span is performed by using the commercial software, ANSYS Mechanical Ansys Parametric Design Language (APDL) Product Launcher 2019 R1. The Figures 6 and 7 show the flow diagram for NEMA VE 1 test and IEC 61537 test.

NEMA – Simple Span test

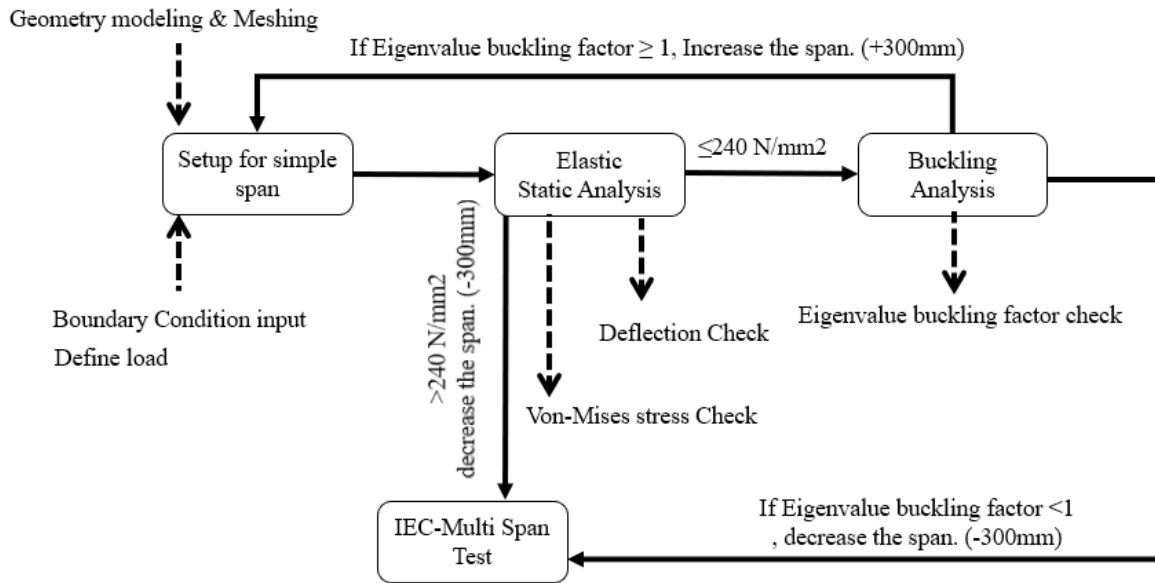


Figure 6. NEMA-Test flow diagram

IEC– Multi Span test

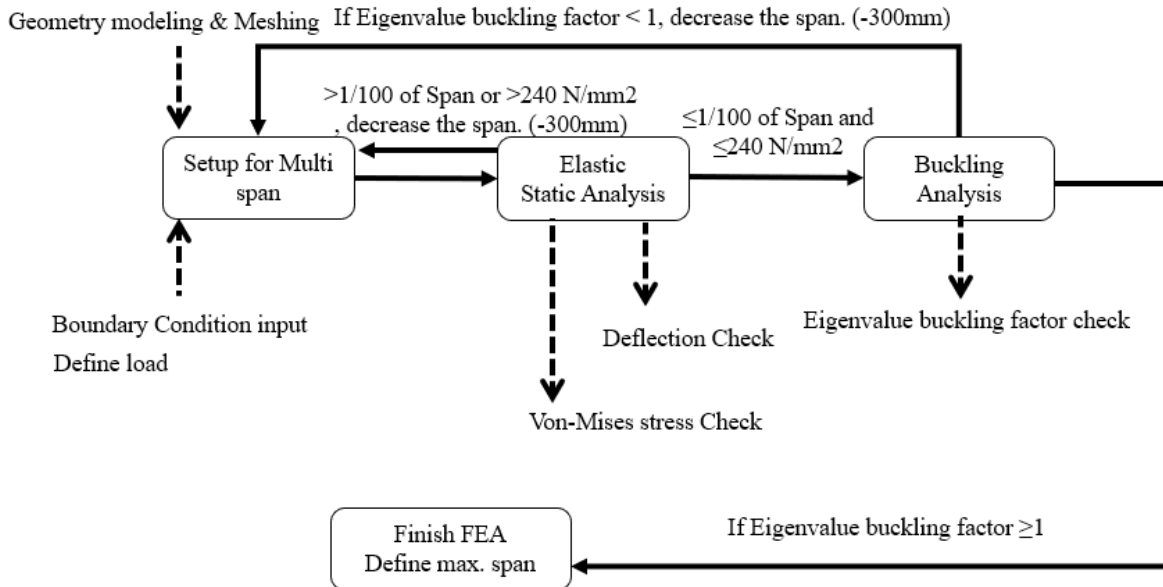


Figure 7. IEC-Test flow diagram

2.4.1 Build the FEA Model

ANSYS shell elements, “SHELL 181”, which is a four-node element with six degrees of freedom at each node, was selected to analyze the stability and the displacement of the ladder when the largest cable load was placed. Figure 8 indicates the direction of the coordinate system.

Modeling for cable ladder was performed based on material property and geometry data shown in Table 2, Table 3, and Figure 2. For meshing, free mesh is used for this study. On top of that, the splicing modeling is not considered for IEC 61537 deflection test because the bending moment at the position of splicing is as small as negligible when it has been placed on 1/4 of span.

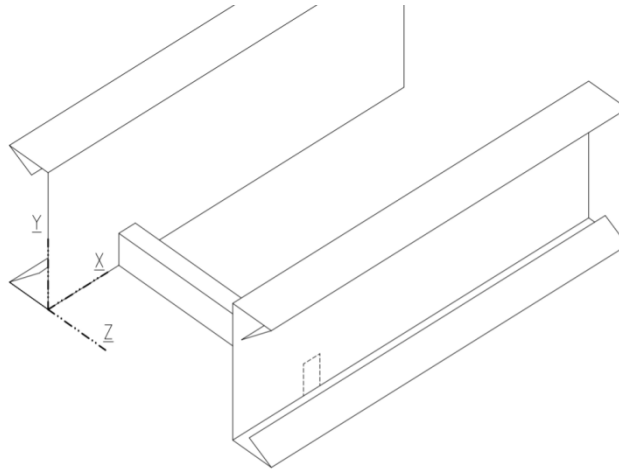


Figure 8. Directions for the coordinate system

2.4.2 Apply Boundary Conditions and Loads

The boundary conditions for the round steel bar supports are shown in Figure 9. The midpoints of both webs are restrained in x, y and z direction on the first support and only in y direction on other supports. However, there is no restraint of rotation in all direction.

The unit load is applied to the elements on the top of rung. Since a rung is spaced in every 300mm, the value of pressure on elements is

$$P = \frac{300(\text{mm}) \times \text{unit load}(\text{N/mm})}{\text{Rung Area}(\text{mm}^2)} \quad (4)$$

where

$$\text{Unit load} = (\text{Maximum cable unit load} + \text{ladder unit weight}) \times \text{Safety factor} \quad (5)$$

and rung area is $900\text{mm} \times 41.7\text{mm} = 37,530\text{mm}^2$, IEC safety factor = 170%, and NEMA safety factor = 150%.

2.4.3 Perform the Analysis of Deflection and Stress

The elastic static analysis is conducted to verify wheth-

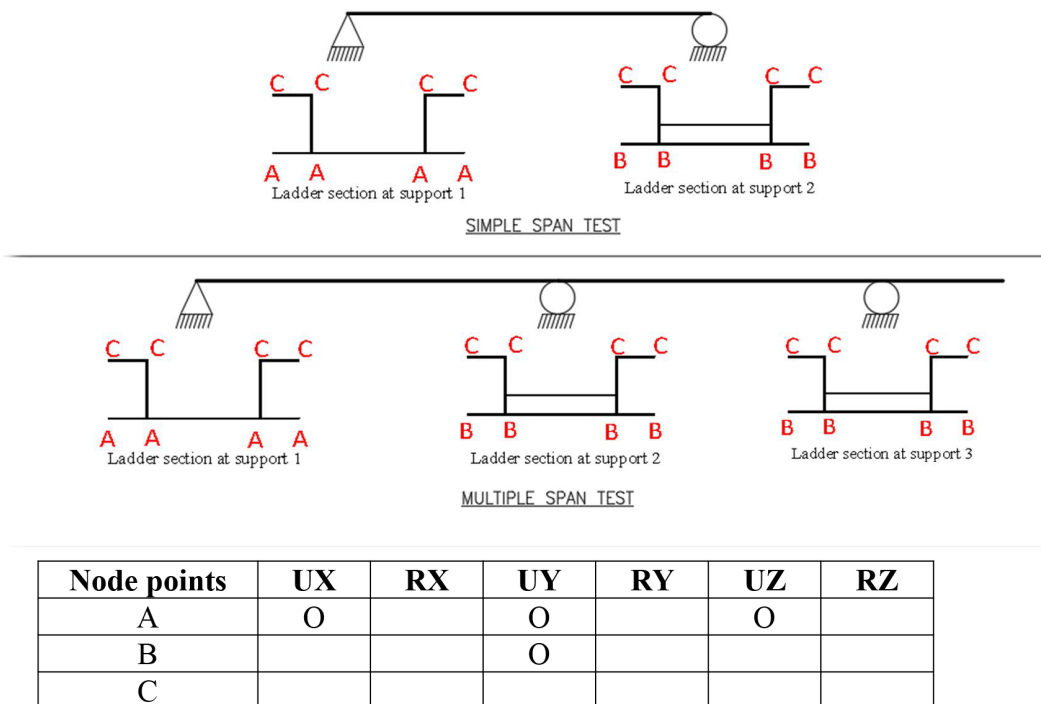


Figure 9. Boundary condition for supports

er the vertical deflection and Von-Mises stress at mid-span do not exceed the criteria in Table 4 when the greatest cable load is placed.

Table 4. The criteria of deflection and stress

Test type	Max. deflection at side rail.	Max Stress (yield stress)
NEMA destruction load test	NA, only record for comparison	<240 MPa
IEC deflection load test	<1/100 of span without collapse	<240 MPa

The maximum vertical deflection at mid-span shall be measured at the points near the side. In other words, the rung sagging displacement (transverse sagging) should be excluded in the calculation of the vertical displacement. For accurate measurement of displacement and stress, those values need to be obtained by using “path operation”. Figure 10 shows the path of measuring point in ANSYS.

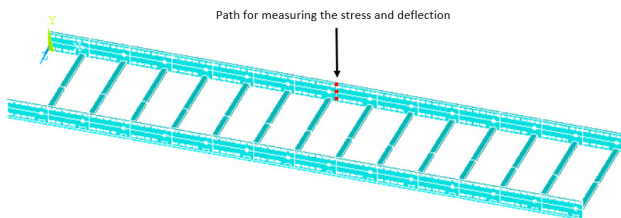


Figure 10. Path for measuring stress and deflection

Table 5 indicates the coordinate of location for “define path” in order to measure the max. stress and max. displacement at mid-span.

Table 5. The coordinate of location for “define path”

Test Code	Span (mm)	Location #1			Location #2		
		X(mm)	Y(mm)	Z(mm)	X(mm)	Y(mm)	Z(mm)
NEMA VE1	3000	1500	0	0	1500	147	0
NEMA VE1	3300	1650	0	0	1650	147	0
NEMA VE1	3600	1800	0	0	1800	147	0
NEMA VE1	3900	1950	0	0	1950	147	0
NEMA VE1	4200	2100	0	0	2100	147	0
IEC 61537	3900	4875[1]	0	0	4875[1]	147	0

Note:

[1] Middle position of intermediate span in multiple span test.

2.4.4 Conduct Eigenvalue Buckling Analysis

Eigenvalue buckling analysis estimates the theoretical buckling strength of an ideal elastic structure. It predicts the structural eigenvalues for the given conditions such as load and constraints. If the eigenvalue under the largest load condition is less than 1, the cable ladder will collapse at the placed load. So, when the result is less than 1, the span of support shall be reduced to avoid the buckling of side rail [17].

2.5 Step 5: Conduct Simplified Hand Calculation

The maximum vertical sagging displacement and the greatest bending stress at middle of span can be estimated based on following simplified formula.

Assumption:

- (1) The material is linear elastic
- (2) The side rail is prismatic, which means that cross-section remains constant throughout its length.

Maximum vertical deflection for simple span in Figure 11 is

$$\delta = \left| \frac{-wx(L^3 - 2Lx^2 + x^3)}{24EI} \right| \tag{6}$$

$$\text{With } \delta_{\max} = \frac{5wL^4}{384EI} \text{ at } x = L/2 \tag{7}$$

where E is Elastic modulus (N/mm²), I is Moment of Inertia of side rail (mm⁴), L is Support span (mm), x is Distance from pin support, w is Load per unit length (N/mm), and δ_{\max} is Maximum deflection (mm).

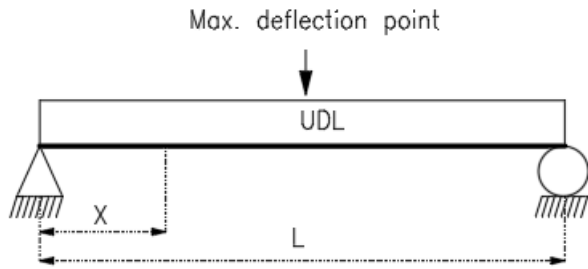


Figure 11. Simple beam with UDL

When cable ladders are installed across several supports with UDL as Figure 12, the maximum sagging displacement is

$$\delta_{max} = \frac{0.0031 \times w \times L^4}{E \times I} \quad \text{at mid of intermediate span (8)}$$

where E is Modulus of elasticity (N/mm²), I is Moment of Inertia of side rail (mm⁴), w is Load per unit length (N/mm), L is Support span (mm), δ_{max} is Maximum deflection (mm), and E and I are constant.

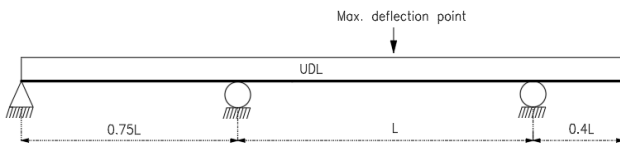


Figure 12. Continuous simply supported beam with over-hanging

Maximum bending stress at middle of span is

$$\sigma_{max} = \frac{M_{max} \times y}{I} \quad (9)$$

with

$$M_{max} = \frac{w \times L^2}{8} \quad (\text{in simple span test}) \quad (10)$$

$$M_{max} = 0.0455 \times w \times L^2 \quad (\text{at intermediate span in multi span test}) \quad (11)$$

where M is bending moment at the middle of span (N·mm), L is support span (mm), w is load per unit length (N/mm), I is moment of Inertia of side rail (mm⁴), y is vertical distance away from the neutral axis (mm), and σ_{max} is Maximum bending stress at the middle of span (N/mm²).

Figure 13 shows the bending moment diagram for the continuous span of IEC 61537. Bending moment for each position indicated in Figure 13 can be calculated as

$$M1: \text{zero from left of beam} = 0 \quad (12)$$

$$M2: 0.27 \times L \text{ from left of beam} = 0.0364 \times w \times L^2 \quad (13)$$

$$M3: 0.75 \times L \text{ from left of beam} = -0.079 \times w \times L^2 \quad (14)$$

$$M4: 1.25 \times L \text{ from left of beam} = 0.0455 \times w \times L^2 \quad (15)$$

$$M5: 1.75 \times L \text{ from left of beam} = -0.08 \times w \times L^2 \quad (16)$$

$$M6: 2.15 \times L \text{ from left of beam} = 0 \quad (17)$$

where w is load per unit length (N/mm) and L is intermediate span length (mm).

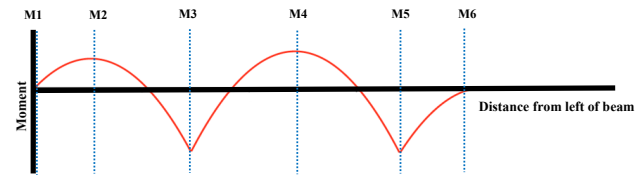


Figure 13. Bending moment diagram for IEC 61537 test

2.6 Step 6: The Validation of the Result

The validation of the result is performed in two ways; one is to compare the result of FEA and the result of hand calculation and the other is to verify the constructability for the greatest span obtained from FEA.

The comparison is made for the deflection and bending stress. If the difference between two outputs is too large to be neglectable, the errors shall be corrected until the gaps reach the acceptable range or a justification for the errors shall be addressed.

In addition, it is required to be validated whether the weight of cable ladder is suitable to handle and install at site when the longest span in FEA is applied. In current practice, the cable ladder is manually handled and installed by maximum of two workers. Therefore, the maximum weight of cable ladder shall be less than two times of the maximum recommended weight for manual lifting defined in National Institute for Occupational Safety and Health (NIOSH). In other words, if the ladder weight is more than 46.26kg, more manpower may be required to handle and install the cable ladder at new span.

$$23.13\text{kg} \times \text{Number of worker (2 persons)} \geq \text{The weight of cable ladder} \geq 46.26\text{kg}$$

where 23.13kg is the maximum recommended weight for manual lifting without injuries in ideal condition^[18].

3. Results

3.1 Maximum Load

Table 6 shows the result of the maximum load calculation. For the finite element analysis and the hand calculation, the safety factor defined in each standard shall be multiplied with the sum of cable weight & ladder weight.

In this study, only data for width 900mm is considered because NEMA VE-1 states the test shall be conducted with the greatest width^[14].

Table 6. The summary of maximum load

Width of ladder [mm]	Max. Cable weight (A) [N/mm]	Ladder weight (B) [N/mm]	Max. load(C) (A)+(B) [N/mm]	NEMA Test (C)*1.5[1] [N/mm]	IEC Test (C)*1.7[2] [N/mm]
300	0.430	0.057	0.487	0.730	0.828
450	0.645	0.062	0.707	1.060	1.202
600	0.860	0.068	0.928	1.392	1.577
750	1.075	0.073	1.148	1.722	1.951
900	1.290	0.078	1.369	2.053	2.327

Notes:

[1] NEMA safety factor: 150%

[2] IEC safety factor: 170%

3.2 Finite Element Analysis

Numerical analysis has been carried out for both NEMA VE-1 destruction load test and IEC 61537 deflection load test.

3.2.1 NEMA VE-1 Destruction Load Test

By using formula (4), the test pressure distributed on the top of each rung has been calculated as

$$0.0164\text{N/mm}^2 = \frac{300(\text{mm}) \times 2.05(\text{N/mm})}{37530(\text{mm}^2)}$$

The Figure 14 shows the largest vertical deflection (vertical sagging of side rail) which is measured at mid-span. It significantly increases as span increases.

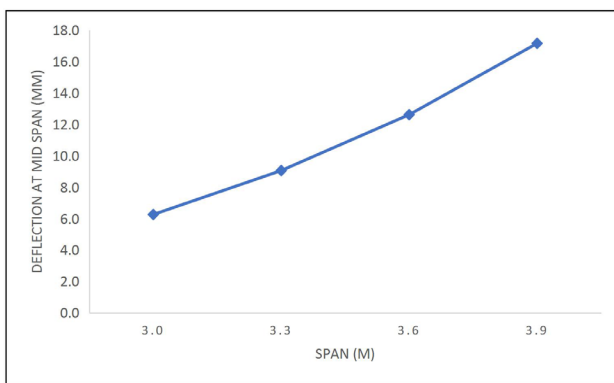


Figure 14. Maximum vertical deflection for simple span

Figure 15 is the trend for Von-Mises stress as span increases. Although the longer the span is, the larger the Von-Mises stress is, the maximum Von-Mises stress at the mid-span did not reach the yield stress of material up to 3.9m span.

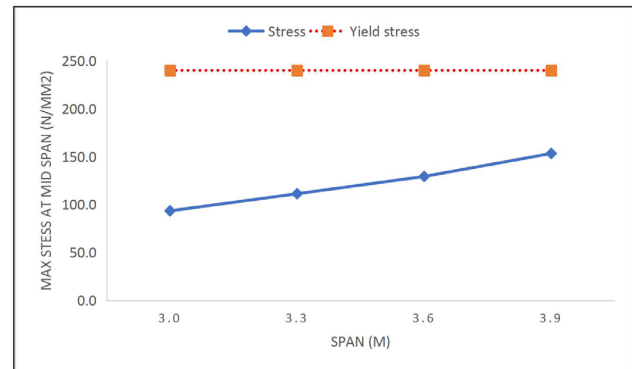


Figure 15. Max. Von-Mises stress for simple span

Based on the stress contour in Figures 16, the largest stress was observed at boundary condition location position of support, but it was neglectable because of the minor area. Other than the stress at boundary condition location, the greatest bending stress was induced on top flange of side rail at mid-span where the largest vertical displacement took place.

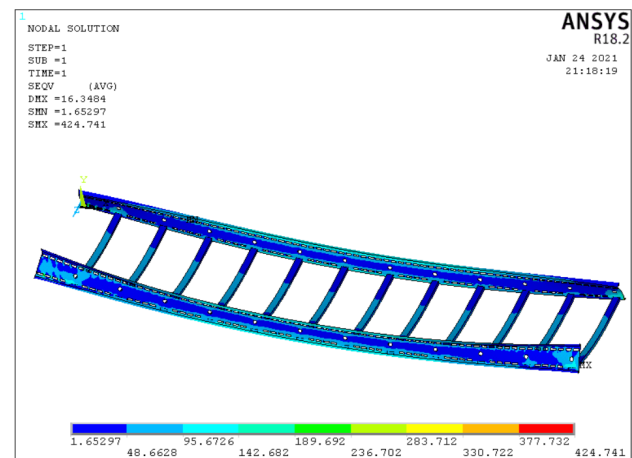


Figure 16. Von-Mises stress contour for NEMA destruction test with 3.6m span

Figure 17 shows the result for eigenvalue buckling analysis when 0.0164 N/mm² is uniformly distributed on the top of rung. As a result, the elastic critical bending moment reached between 3.6m span and 3.9m span because eigenvalue buckling factor in this region became less than 1. Therefore, it concludes that the largest span of NEMA test simulation is about 3.6m.

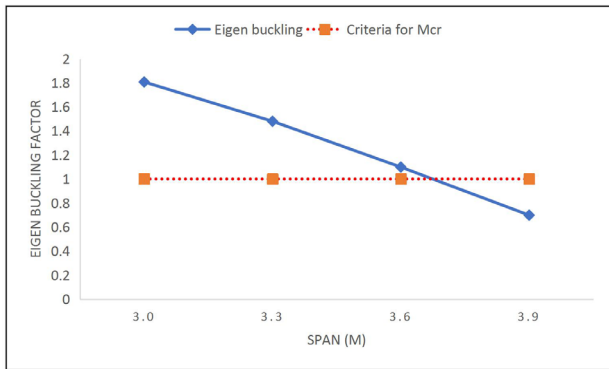


Figure 17. Eigenvalue buckling factor for simple span

3.2.2 IEC 61537 Deflection Load Test

The pressure for each rung for deflection load test is:

$$0.0186\text{N/mm}^2 = \frac{300(\text{mm}) \times 2.33(\text{N/mm})}{37530(\text{mm}^2)}$$

The finite element analysis for IEC 61537 load test was performed only at the longest span (3.6m) which met NEMA VE-1. Figure 18 is stress contour for multi-span (IEC 61537) condition. As for simple span (NEMA VE-1 load test), the greatest stress was found at the boundary condition of the support and it is neglectable due to the minor area near hole. Other than the stress at support position, the maximum bending stress occurred on the top flange of side rail at middle of intermediate span where the largest vertical displacement was observed.

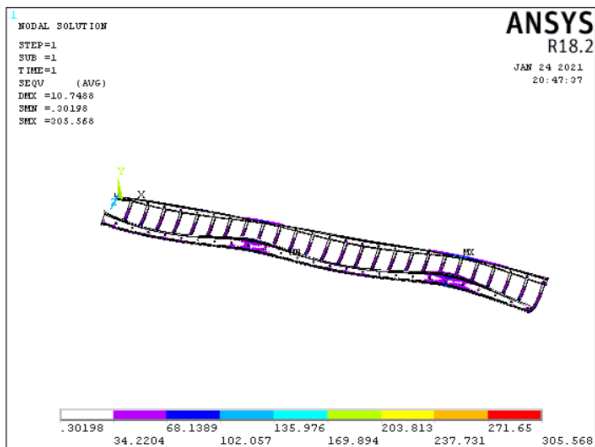


Figure 18. Von-Mises stress Contour for IEC deflection test with 3.6m span

Figure 19 is deformed shape of buckling for IEC test. Eigen buckling factor is 2.16 which is almost 2 times of Eigen buckling factor in simple span load test.

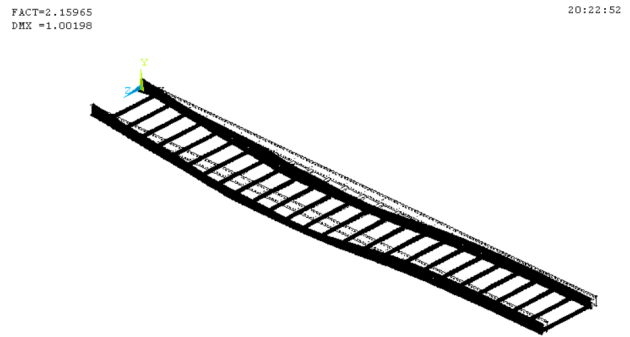


Figure 19. Deformed shape of buckling for IEC deflection test with 3.6m span

Table 7 is comparison of results between NEMA load test (simple span) and IEC load test (multiple span). All outcomes of the multiple span are much more positive than that of simple span.

Table 7. Simple span versus multi-span at 3.6m span

Value	NEMA-simple span (A)	IEC-multi span (B)	Criteria	(A)/(B)
Max. deflection at mid-span (mm)	12.6	2.9	≤39 ^[1]	4.34
Max. bending stress at mid-span (N/mm ²)	129.4	51.0	≤240 ^[2]	2.54
Eigenvalue buckling factor	1.10	2.16	≥1	0.51

Notes:

[1] 1/100 of 3600mm

[2] Yield stress of material

In summary, 3.6m is the maximum span which doesn't reach critical bending moment for buckling, yield stress and 1/100 of deflection.

3.3 Simplified Hand Calculation

The simplified hand calculation has been carried out up to the longest span (3.6m) which doesn't reach buckling in numerical analysis. Figures 20 and 21 show the results for the maximum deflection and bending stress at the mid-span. As a result, the vertical deflections of the cable ladder were less than 1/100 of span over whole test span. Moreover, both cases (IEC load test & NEMA load test) did not reach the yield stress of material.

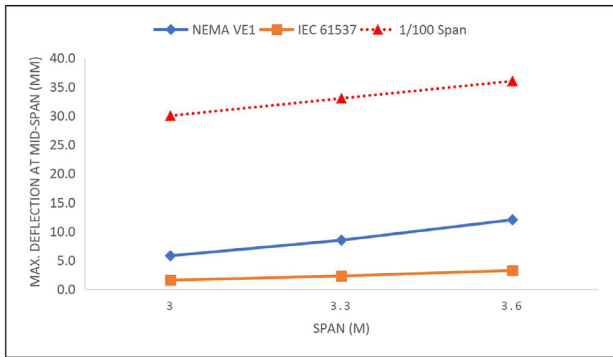


Figure 20. Max. deflection at the middle of span

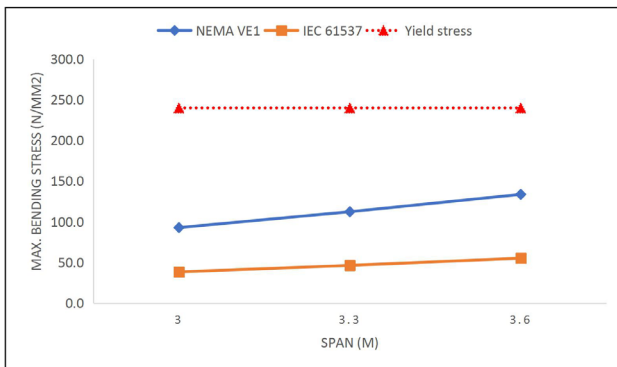


Figure 21. Max. bending stress at the middle of span

3.4 Comparative Analysis

As given in Table 8, a comparison is made with the hand calculation results and results obtained from FEA. Overall, the results present a good correlation. The maximum error is about 10% in the deflection of 3.6m span (IEC) and it might occur because not only the effects induced the holes in the web were not considered in simplified hand calculation but also allowing the beam to rotate around the longitudinal axis.

Table 8. Hand calculation versus FEA

Span (m)	Max deflection at mid-span (mm)			Max bending stress at mid-span (N/mm ²)		
	Hand Cal.(A)	FEA(B)	(A)/(B)	Hand Cal.(C)	FEA(D)	(C)/(D)
3(NEMA)	5.8	6.3	0.93	92.8	93.5	0.99
3.3(NEMA)	8.5	9.1	0.94	112.3	111.4	1.01
3.6(NEMA)	12.0	12.6	0.95	133.6	129.4	1.03
3.9(NEMA)	16.5	17.2	0.96	156.8	153.4	1.02
3.6 (IEC)	3.2	2.9	1.10	55.1	51	1.08

3.5 Constructability Verification

The straight length of cable ladder shall be at least equal to the longest span (3.6m) obtained from FEA because more than two splicing units between supports are not allowed^[14]. In other words, the straight length of cable ladder is not able to be shorter than support span, 3.6m in order to minimize its weight

The weight of 3.6m cable ladder is $8\text{kg/m} \times 3.6\text{m} = 28.8\text{ kg}$

It concludes the longest span from FEA is acceptable in view of material handling because its weight meets the criteria ($\leq 46.26\text{kg}$) in section 2.6.

3.6 Case study

Table 9. Input data for case study^[19]

Data description	Data detail	Remark
Project	A liquified natural gas terminal facility	
Supplied cable ladder straight section	7620m	
Support material cost	\$100	the lowest cost
Splicing unit material cost (per 1 pair)	\$10/pair ^[1]	
Labor rate	\$60 (\$/hour)	
Support installation time	6 hour/ea	
Cable ladder splicing time	0.25 hour/pair	

Note:

[1] This cost is obtained via personal communication.

To estimate the benefits from the longer support span, a liquified natural gas (LNG) terminal facility project was

selected for the case study. This LNG facility had been built by using B-line’s products and all required information for the case study is available in the paper generated by B-line. This study explains what kinds of benefits compared to the design based on 3m span can be obtained by utilizing 3.6m support span which is quite feasible in view of constructability.

The case study was carried out as following steps.

Step 1: To define the input data for case study.

The information from B-line’s LNG facility project was used for the case study. Table 9 shows the input data to evaluate the economic impacts of longer span.

Step 2: To estimate the reduced quantity of support.

According to B-line’s bill of material for target project, total 7620m cable ladder straight section had been supplied. By using total length of cable ladder straight section, minimum required support quantity for each span can be calculated as

$$\text{Minimum support Qty(ea)} = \frac{\text{Total length of cable ladder straight section(m)}}{\text{Support span(m/ea)}}$$

where

$$\text{Total support for 3m span: } 2540\text{ea} = \frac{7620\text{m}}{3\text{m/ea}}$$

$$\text{Total support for 3.6m span: } 2117\text{ea} = \frac{7620\text{m}}{3.6\text{m/ea}}$$

As a result, total 423ea structural steel support for cable ladder straight section can be roughly reduced by changing the support span from 3m to 3.6m.

Step 3: To calculate the positive cost impacts for support material.

The cost for 423ea steel structural support is:

$$\text{Support material cost savings(\$)} = \text{Saved support Qty(ea)} \times \text{Unit price for support (\$/ea)}$$

$$42,300(\$) = 423(\text{ea}) \times 100 (\$/\text{ea})$$

Step 4 To evaluate the cost savings for splicing unit.

The splicing units of cable ladder are demonstrated in Figure 22. The splicing units are used for connecting the two pieces of cable ladder straight section. In general, one pair splicing unit is required for each support span length because cable ladder straight section length is equal to support span length to minimize its weight. Thus, reduced splicing unit quantity is same as the saved support quantity.

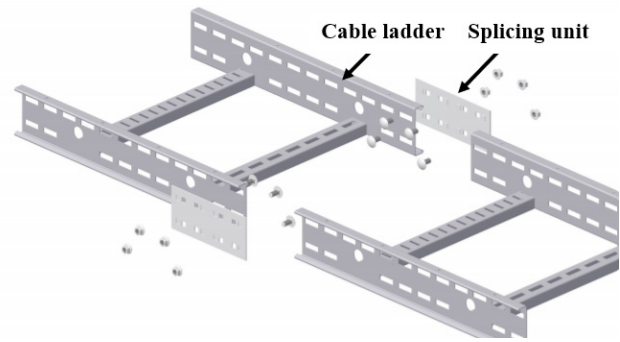


Figure 22. Splicing unit for cable ladder^[13]

Splicing unit material coat savings (\$)

$$= \text{Reduced splicing unit Qty(pair)} \times \text{Unit price of splicing unit (\$/pair)}$$

$$4,230 (\$) = 423 (\text{ea}) \times 10 (\$/\text{ea})$$

Step 5 To obtain the labor cost savings for cable ladder support installation.

Labor cost savings for cable ladder support installation are:

$$= \text{Labor rate (\$/hour)} \times \text{Manhour for installation (hour/ea)} \times \text{Saved support Qty(ea)}$$

$$152,280 (\$) = 60 (\$/\text{hour}) \times 0.25 (\text{hour/pair}) \times 423 (\text{pair})$$

Step 6 To get the labor cost decrease for cable ladder splicing.

The labor cost impacts for cable ladder splicing can be calculated as below:

$$= \text{Labor rate (\$/hour)} \times \text{Manhour for splicing (hour/pair)} \times \text{Reduced splicing unit Qty(pair)}$$

$$6,345 (\$) = 60 (\$/\text{hour}) \times 0.25 (\text{hour/pair}) \times 423 (\text{pair})$$

Step 7 To summarize the benefits of new span.

Total economic benefits by employing optimal span, 3.6m are summarized in Table 10. Compared to 3m support span design, about 205,155\$ can be lower by utilizing the 3.6m support span.

Table 10. Summary of cost savings

Description	Cost savings (\$)
Cable ladder support material	42,300
Splicing unit material	4,230
Labor cost for support installation	15,2280
Labor cost for cable ladder splicing	6,345
Total cost savings	205,155

4. Discussions

In cable ladder system design, although the cable

weight is a chief factor to determine the support span, the method to calculate maximum cable load had not been well defined in earlier research studies. By using the formula derived in this research, the maximum cable weight to be installed on the ladder can be estimated.

The cable ladder which is a kind of slender steel beam might fail due to lateral torsional buckling before yielding the plastic hinge. Through FEA, the greatest span has been estimated as 3.6m when the C channel side rail in Figure 2 is applied. Compared to the span length of offshore practice, it makes 20% improvement without increasing the cross-section of cable ladder and contributes to reduce the overall ladder system cost such as material cost, labor cost and others.

In view of constructability, the weight of 3.6m straight ladder is suitable for manual handling and installation and it is able to give more attractive results when it is applied to the larger project that the proportion in the straight run of cable ladder is greater.

Although there were some approaches to extend the span by increasing the thickness of side rail, it might be a big challenge in view of constructability. For instance, it not only causes the difficulty of material handling because of getting much heavier but also increases the risk of injury during the installation of heavier ladder.

Finally, although the optimal span in this study does not give the large cost saving in view of total project cost, it can be one of contributions to save offshore oil and gas project cost.

5. Conclusions

The findings from this study can be summarized as:

According to data from previous projects, the dominated maximum cable ladder support span is 3m. Both NEMA VE-1 and IEC 61537 are the mainly used standards to determine the largest support span in offshore oil and gas industry. However, there is no well-defined guidance to estimate the greatest cable weight which can be filled on the cable ladder.

On top of that, the formulas in the structural steel design standard such as CAN/CSA S16-14, Eurocode 3 are difficult to be used to get the critical bending moment of cable ladder due to its geometry partially restrained by rung.

(1) According to NEC, control cables can be filled much more in cross section of cable ladder compared to power cables because they do not cause the heat generation problem. Therefore, the largest cable weight which can be calculated by assuming 50% of fill area of cable ladder is fully filled with the control cables.

(2) Based on the side rail geometry frequently used in

offshore industry, FEA has been conducted to find the longest span which meet both NEMA VE-1 and IEC 61537. As a result, optimal span is 3.6m which is 0.6m longer compared to the offshore typical practice. Moreover, the weight of cable ladder for new span is still suitable for material handling without additional manpower.

(3) When a longer span was applied to a liquefied natural gas terminal facility as case study, about 17% cost saving could be obtained for cable ladder support system. Although the proportion of cable ladder support system in the cost of the project is small, it can be one of the contributions to save offshore oil and gas project cost.

References

- [1] Sieminski, A. International energy outlook. Energy information administration (EIA), 2014, 18.
- [2] IOSS. IOSS Introduction [Online], 2015. Available: <https://ioss.info/page/index.php> [Accessed].
- [3] Ekstrom, C. M., Wesley, D. Lateral-torsional Buckling of Steel Channel Beams. Division of Structural Engineering Chalmers University Of Technology Gothenburg, 2017.
- [4] Kalupa, C.J. Guide for design of electrical cable tray systems[J]. IEEE Transactions on Industry Applications, 1977, 6: 533-538.
- [5] Desmond, T.P., Dermitzakis, S.N. Effective-length factors for buckling of cable-tray supports[J]. Nuclear Engineering and Design, 1987, 103(3): 313-332.
- [6] Reigles, D.G., Brachmann, I., Johnson, W.H., Gürbüz, O. Test-based approach to cable tray support system analysis and design: Behavior and test methods[J]. Nuclear Engineering and Design, 2016, 302: 27-36.
- [7] Masoni, P., Pasquale, G.A., Mazzieri, C., Morgana, A. Seismic tests of cable tray systems, 1989.
- [8] Huang, B., Lu, W., Mosalam, K.M. Shaking table tests of the cable tray system in nuclear power plants[J]. Journal of Performance of Constructed Facilities, 2017, 31(4): 04017018.
- [9] Khalid, M., Baofeng, H. Performance-based Earthquake Engineering Methodology For Seismic Evaluation Of Cable Tray Systems For Nuclear Power Plants, 2019.
- [10] De Normalisation, C. E. ENV 1993-1-1 Eurocode 3, design of steel structures, Part 1.1-General rules and rules for buildings. European Committee for Standardization, Brussels, Belgium, 1993.
- [11] EN, B. 10088-1: 2005, Stainless Steels-Part1: List of stainless steels. CEN, 2005.
- [12] EN, B. 10088-2: 2014. Stainless steels: technical delivery conditions for sheet/plate and strip of corro-

- sion resisting steels for general purposes, 2014.
- [13] Oglaend. Oglaend system product [Online]. 2020b. Available:
<https://www.oglaend-system.com/selector/> [Accessed].
- [14] NEMA. NEMA VE 1-2017 Metal Cable Tray Systems. National Electrical Manufacturers Association, 2017.
- [15] Commission, I. I. E. IEC 61537: Cable management—Cable tray systems and cable ladder systems. Geneva (Switzerland): International Electrotechnical Commission, 2016.
- [16] Association, N. F. P. NFPA 70: National Electrical Code, National Fire Protection Assoc, 2011.
- [17] University of Alberta. Buckling [Online], 2020. Available:
<https://sites.ualberta.ca/~wmoussa/AnsysTutorial/IT/Buckling/Buckling.html> [Accessed].
- [18] Waters, T. R., Putz-Anderson, V., Garg, A. Applications manual for the revised NIOSH lifting equation, 1994.
- [19] B-Line. Cost saving calculator [Online], 2020a. Available:
<https://www.eaton.com/content/dam/eaton/products/support-systems/cable-management/structural-steel-savings/structural-steel-savings-engineering-guide-brochure.pdf> [Accessed].